

# Analysis of Breakdown Mechanisms in Heated Short Air Gaps During Contact Opening in Compact DC Circuit Breakers

Jing Nan, George Chen, Igor O. Golosnoy  
*School of Electronics and Computer Science*  
*University of Southampton*  
Southampton, UK  
J.Nan: jn1n19@soton.ac.uk

**Abstract**—DC commutative circuit breakers, characterised by their compact size and rapid commutation capabilities, are increasingly recognised for their potential in DC circuit interruption. However, challenges such as arc re-ignition significantly hinder their scalability. This paper reviews traditional predictive models for breakdown behaviours, particularly Paschen's Law and Critical Field Theory, to explore their adequacy in explaining the mechanisms behind re-ignition post-commutation. This research addresses the observed discrepancies between theoretical predictions and experimental results in compact LC commutative circuit breakers, particularly in scenarios involving rapid contact separation and the presence of hot gas in the gap. It proposes that the Critical Field Theory, due to the remaining noticeable background ionisation, more accurately describes the breakdown mechanism during contact opening. The proposed study integrates detailed modelling of temperature distribution, electrical phenomena associated with the arc, and airflow effects within the air gap, supported by experimental validations. The findings enhance our understanding of the electrical breakdown dynamics and provide insights into improving the design and reliability of DC circuit breakers.

**Index Terms**—DC Circuit Breakers, Arc Re-ignition, Paschen's Law, Critical Field Theory, Air Breakdown

## I. INTRODUCTION

DC commutative circuit breakers, noted for their compact size and rapid switching capabilities, have emerged as a promising technology for interrupting DC power flows. Despite these advantages, their widespread application is hindered by persistent issues related to arc re-ignition [1], [2]. This phenomenon remains poorly understood, particularly whether it occurs due to voltage levels exceeding the critical breakdown field, or because the oscillation peak current fails to cross zero, leading to commutation failure [1]. Conventional models like Paschen's Law and Critical Field Theory have historically been utilised to predict breakdown voltages [3]. Paschen's Law, an empirical formula, dictates the necessary voltage to initiate a discharge within a uniform electric field, considering the product of pressure and electrode distance ( $pd$ ) as the key variable. This law reveals a minimum voltage threshold required to break a gap of any size [3], [4]. The theory primarily relies on Townsend's avalanche

theory, which posits that  $pd$  is the controlling variable in discharge phenomena. However, this model does not fully encompass the various factors contributing to gas ionisation under applied voltage conditions [3]. Recent studies have proposed modifications to this law by incorporating thermal effects to better predict breakdown scenarios under varying conditions [5]. Further, research by sources such as [6] and [7] indicates that in gaps up to the few micrometres scale, the breakdown mechanism transitions from Townsend's avalanche to field emission. This shift marks a pivotal change; the breakdown becomes predominantly dependent on the critical field strength, which varies significantly with temperature due to its impact on gas component density and the ionisation process involving attachment and detachment. This critical field is highly temperature-sensitive and becomes the primary determinant in such scenarios.

Despite the theoretical frameworks provided by both Paschen's Law and Critical Field Theory, there is a noticeable discrepancy in breakdown behaviours observed in experiments, particularly in small gap sizes, regardless of whether the gas is cold or hot as Figure 1 and Figure 2. This discrepancy poses a significant challenge in explaining the mechanisms behind re-ignition post-commutation for the LC commutator-based circuit breakers. Our research seeks to understand whether the re-ignition phenomena in compact circuit breakers adhere to the expected theoretical pathways, particularly under conditions of rapid contact separation where hot gas mixed with metal vapour dominates the gap. This paper hypothesises that the presence of hot air significantly contributes to an average background electron density due to electrons' high diffusion coefficient, despite the presence of a colder boundary layer. We propose that the critical field theory is more applicable to the conditions within compact circuit breakers, particularly due to noticeable background ionisation shortly after contact separation.

This paper investigates these discrepancies by exploring the breakdown mechanisms in short air gaps during contact opening processes. The research incorporates a detailed modelling approach that accounts for the temperature distribution

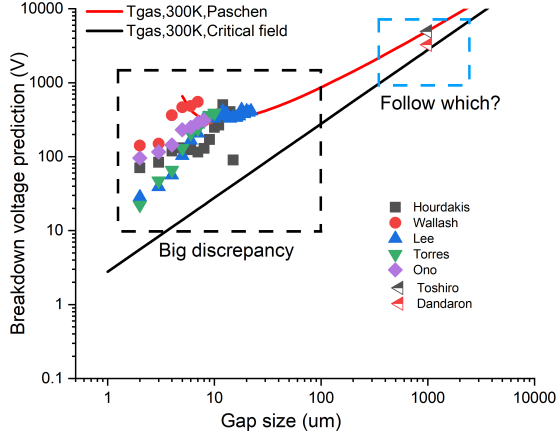


Fig. 1. Breakdown voltage predictions for 300K air using Paschen's Law and Critical Field Theory versus experimental data from [3], showing significant discrepancies in the micrometre gap size range

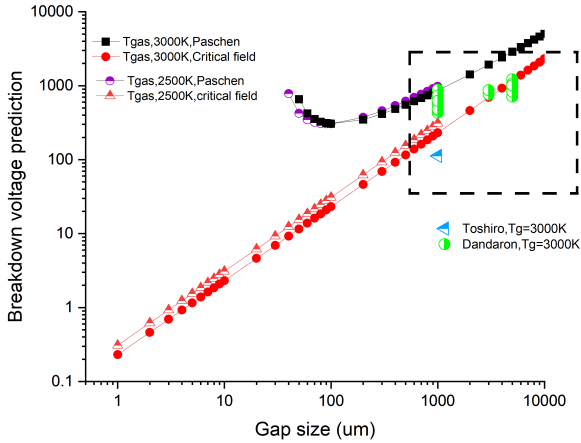


Fig. 2. Breakdown voltage predictions for 3000K and 2500K air using Paschen's Law and Critical Field Theory versus experimental data from [5] and [8], showing significant discrepancies in the millimetre gap size range

within the air gap and the electrical phenomena associated with the arc. Also, our model integrates the effect of airflow initiated upon contact opening, which cools the arc and potentially influences the breakdown process. The model was supported through experimental validations, and the findings demonstrate a promising alignment between model prediction with observed experimental data, offering new insights into the complex dynamics of electrical breakdowns in air gaps.

## II. MODEL FORMULATION

### A. Modified Paschen's Law

For a basic configuration involving two electrodes separated by a gas, Paschen's law that describes the electrical breakdown voltage  $V_B$  of a gas as a function of its pressure  $P$  in [Torr],

the distance  $d$  in [cm] between two electrodes, and the gas composition [4].

$$V_B = \frac{Bpd}{\ln(Apd) - \ln\left[\ln\left(1 + \frac{1}{\gamma_{se}}\right)\right]} \quad (1)$$

In Equation 1,  $\gamma_{se}$  represents the secondary electron emission influenced by ions from the electrode's material. Constants  $A$  and  $B$  are derived empirically for individual gases. For Air,  $A=15$  [1/cm/Torr],  $B=365$  [V/cm/Torr],  $\gamma_{se}=0.01$  [9]. With increased gap distances and pressure, there's an approximate proportionality between the breakdown voltage and the product of pressure and gap distance. At extremely low  $pd$  values, Paschen's law suggests that initiating a discharge could be impossible. But contrary to this indication, a discharge can still happen, as its initial considerations overlook the certain effects of the surface field emission as well as temperature effect [10], as in Figure 1 and Figure 2. Hence, the first modification we took modified Paschen's law by linking the thermal effects.

$$V_{B1} = \frac{Bpd\frac{T_0}{T_g}}{\ln(Apd\frac{T_0}{T_g}) - \ln\left[\ln\left(1 + \frac{1}{\gamma_{se}}\right)\right]} \quad (2)$$

Here, the reference temperature  $T_0$  is 300K and  $T_g$  represents the temperature of the air gap. However, the experimental test results illustrate that Paschen's law is only applicable at 2200K [5]. Because for arcing phenomena, even after the current is commutated to the LC branch, the temperature remains in the gap still higher than 2200K, it necessities to investigate another mechanism to evaluate the breakdown voltage for the evaluated temperature. The accurate prediction of gas breakdown in millimetre-scale gaps is crucial for post-commutating stages, the conventional method of predicting the breakdown voltage through Paschen's law fails in millimetre-scale gaps, the discrepancy arises because the mechanism driving the breakdown shifts from the Townsend avalanche to the field emission as highlighted by [6].

### B. Critical Field Approximation

The calculations reveal that the reduced critical field of dry air remains relatively constant up to temperatures of 2000K, and decays linearly up to around 4000K, then reaches the constant value at the higher temperature as shown in Figure 3. The critical field is lower than the dielectric strength: the former allows ionisation to overcome attachment raising current conduction in the gas, and the latter is affected by electron losses mainly due to diffusion to the areas around the streamer head. In the case of significant background ionisation, the diffusion losses play a smaller role and the breakdown happens at the critical field. This observation is grounded in data from published experiments as [11]. Beyond 2000K, we have extrapolated the critical reduced breakdown field values using simple mathematical interpolation to predict their behaviour. The reduced electric field strength is denoted as  $E_{red}$ , signifies the net electric field effect resulting from the attachment and detachment processes of charged particles

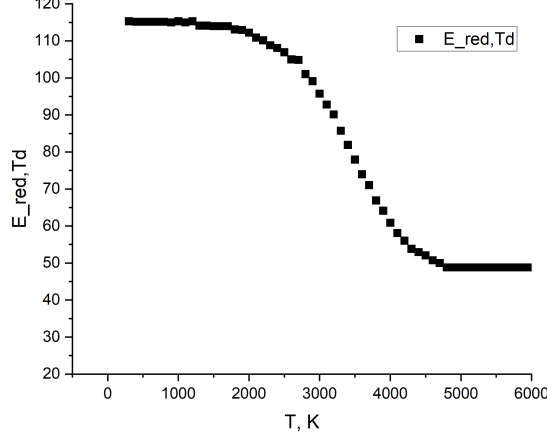


Fig. 3. The relationship between critical field and temperature adapted from [11]

within air during electrical breakdown. This field strength is typically measured in Townsend  $Td$ , with one Townsend  $1Td$  being equivalent to  $1 \times 10^{-21} [V \cdot m^2]$  [11].

Consequently, the critical electric field for breakdown,  $E_{critical}$ , can be calculated using the following equation:

$$E_{critical} = E_{red} \cdot N(T_g) \cdot Td \quad (3)$$

where  $E_{red}$  represents the reduced electric field,  $N(T_g)$  is the number density of particles at temperature  $T_g$ .

The number density  $N(T_g)$  can be determined by:

$$N(T_g) = \frac{P}{K_b \cdot T_g} [1/m^3] \quad (4)$$

where  $P$  is the pressure,  $K_b$  is the Boltzmann constant, and  $T_g$  is the gas temperature.

By combining the equations for the reduced electric field and the number density, the breakdown field can be accurately calculated. To calculate the breakdown voltage in the uniform electric field across the electrode gap, the equation is formalised as:

$$V_{B_2} = E_{critical} \cdot d \quad (5)$$

where  $d$  signifies the total gap distance in  $m$ . This calculation provides a more accurate estimation of the breakdown voltage by accounting for the temperature distribution between the electrodes.

### III. MODEL IMPLEMENTATION

#### A. Modelling of Thermal Plasma

Our research utilises established plasma simulation methods governed by Magnetohydrodynamic (MHD) principles, with the system dynamics derived from the fundamental conservation laws for mass, momentum, and energy as detailed work in [12]. These are expressed through fluid flow differential equations and supplemented by Maxwell's equations

to capture electromagnetic phenomena including electrical potential, current density, and magnetic flux density [13]. To estimate radiation-induced energy losses, we employ the Net Emission Coefficient (NEC) method [14]. The simulated geometry features two symmetric cylindrical electrodes, set within a cylindrical air domain, maintaining consistency with the detailed thermal plasma model settings from previous publication [15], the computational domain are detailed as Figure 4. Notable adjustments in this model include the gap size between the two electrodes, which starts at  $40\mu m$ , and a modified sheath layer thickness, reduced to  $0.01mm$  in response to the decreased gap size. These refinements are designed to verified the model by the experimental data from [1], [2].

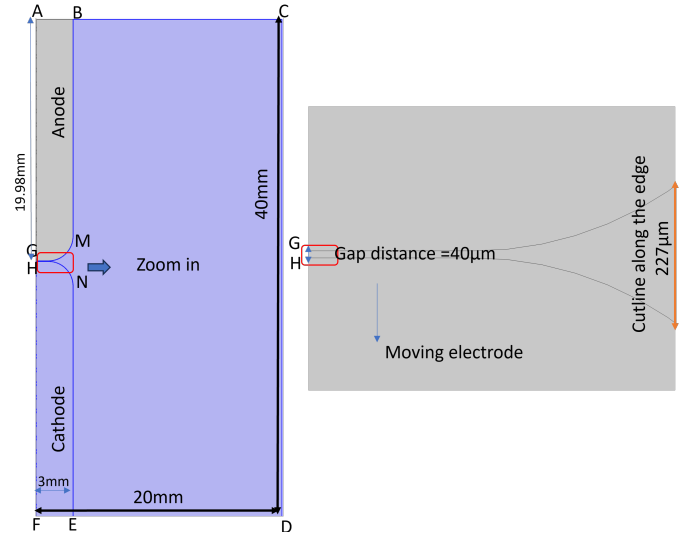


Fig. 4. Details of computational domain of two cylindrical electrode circuit breakers, anode and cathode are made by copper, remain is air domain, the initial gap size is  $40\mu m$ , and a defined 2D cut-line is marked as  $227\mu m$

#### B. Moving Contacts Coupling

This model is designed to simulate the dynamics of electrode movement during contact separation in a circuit breaker. The separation process is characterised by applying a specific velocity to the cathode, and the moving mesh method is utilised to manage this dynamic interaction. In Figure 4, the domain undergoing deformation is highlighted in purple, indicating the area affected by the motion. Despite the movement, the overall computational domain remains fixed, with changes in the area of the cathode effectively representing the electrode's motion. Boundary conditions are set as follows:

- Symmetry/Roller condition is set to HG, HF, NE.
- Prescribed mesh displacement:  $dr = 0$  in  $r$  direction,  $z(t) = z_0 + V_e \times t$ , in this case,  $z_0$  is  $40\mu m$  as initial gap size and the  $V_e$  is moving velocity and specify to top surface of cathode boundary HN.
- Fixed boundary is specified to anode surface boundary BMG and the whole external boundary BC,CD,DE,EF.

### C. Commutation Circuit Description

The thermal plasma model is integrated with an external LC commutation circuit to accurately simulate the DC interruption process in commutative circuit breakers as shown in Figure 5. The schematic diagram features three branches: The main

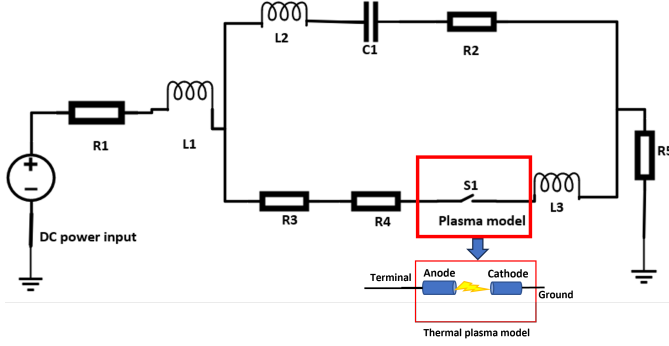


Fig. 5. Schematic of the equivalent electric circuit of circuit breaker coupled with physical thermal plasma model

branch includes a DC power supply, a transmission line resistance  $R_1$ , an inductance  $L_1$ , and a small resistance  $R_5$  that represents the connecting wire resistance. The commutation branch contains a smaller inductance  $L_2$  and a capacitor  $C_1$  forming an oscillatory circuit designed to transfer the fault current into this branch. It also includes  $R_2$ , which represents the line resistance of the LC branch. The circuit breaker branch consists of three components—connecting wires, an arc sheath, and an arc core—represented by  $R_3$ ,  $R_4$ , and the terminal coupled with a thermal plasma model ( $R_{gap}$ ), respectively. A small inductance  $L_3$  is included in this branch to enhance the model's stability by emulating the inductance of this branch. The circuit parameters are detailed in the study [15].

In this updated approach, the arc sheath effect in  $R_4$  is monitored by measuring the interface surface temperature between the hot plasma and the electrodes, utilising two probes at Point G and Point H in Figure 4. An approximation is devised to establish a more realistic dependence of sheath voltage on arc current with a model voltage  $V_b(I)$ . This setup accounts for the real circuit behaviours, where, the voltage drop across the sheath increases for small currents. Consequently, the voltage in the sheath, calculated as  $I \times R_{gap}$ , cannot exceed a specified 'breakdown' voltage  $V_b$ . Any arc voltage exceeding  $V_b$  leads to current rise and associated reduction in arc voltage.

## IV. RESULTS DISCUSSION AND VERIFICATION

### A. Results for larger air gaps with moving electrode

According to the experimental test results reported by [2] in their Figure 15, the experiments indicate a failed current breaking at 1.4 kV DC. The results demonstrate that with the gap opened, it takes approximately 30 to 40  $\mu s$  for the arc to burn, but the arc is finally interrupted. However, re-ignition is observed 200  $\mu s$  later, with the re-ignition voltage

approximately 700 V. In our model, the  $v_e$  contacts separation velocity is set as 5m/s to the bottom electrodes as the experiment setting.

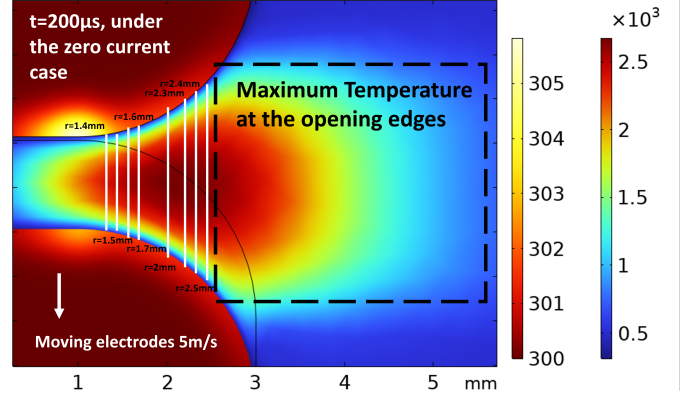


Fig. 6. Temperature distribution between 1mm gap size with moving velocity is 5m/s,  $t=200\mu s$ , illustrating the maximum temperature at the opening edges

In our model, we observed that after the circuit disconnection, the gap between the two electrodes remains relatively cold, while the hottest part concentrates around the curved edges of the electrodes as Figure 6. To evaluate the maximum voltage that this region can withstand, we defined several cut lines across the air gap for assessment as shown in Figure 6. The temperature distribution across different cut-lines is

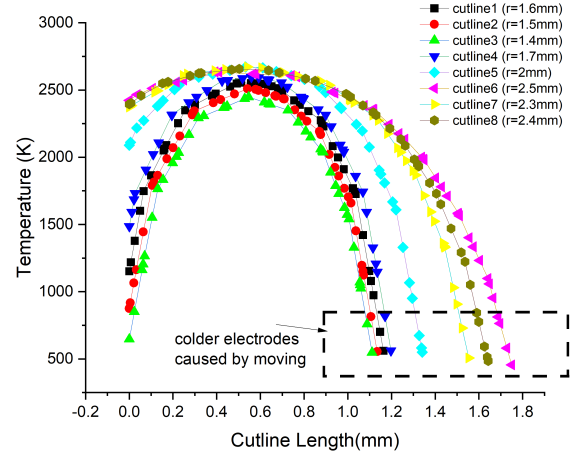


Fig. 7. Temperature distribution along the cut-line across the hottest part of gap, colder electrodes are observed because of moving

illustrated in Figure 7. After circuit disconnection, the gas temperature in the gap remains below 2500K. The bottom electrodes exhibit lower temperatures because the movement of the electrodes draws cold surrounding air into the gap. The hottest position is identified at cutline 6 ( $r=2.5mm$ ). Upon determining the temperature of the gas, and in combination with Equation 4 and Equation 3, then the breakdown voltage

across the gap could be calculated as Equation 6.

$$V_{br} = \int_0^{\text{Gap size}} E_{\text{critical}}(T(z)) dz \quad (6)$$

The predicted breakdown voltages are listed in the figure 8 according to various prediction mechanisms. Our results

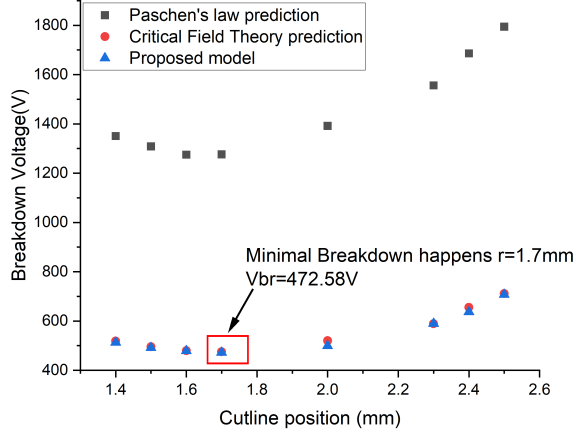


Fig. 8. Predicted Breakdown Voltage across the different cut-line for large gap size, illustrating the minimal breakdown happens at  $r=1.7\text{mm}$  and the breakdown voltage is around 473V, both Paschen Law and Critical Field models use an average temperature, whereas the proposed model takes into account variation in the gap

indicate that the minimal breakdown occurs at  $r=1.7\text{mm}$ , with a breakdown voltage of 473V in our model. We find that the breakdown is highly dependent on the position of the cutline. Experimentally, the breakdown occurs at 700V, which deviates significantly from the predictions of Paschen's law. However, the critical field theory provides a plausible explanation for the breakdown occurrence, though some discrepancies remain.

One potential cause for this discrepancy is that, in our simulation, the electrode geometry is different from the experiment and also our modelling domain is quite small with strong effects of the boundary conditions. This is discussed further in the analysis section.

### B. Results for short air gaps within fixed electrode

Another re-ignition scenario was examined by [1], which documents a failed commutation at 430A and  $C_1=208\mu\text{F}$ . Their observations indicated that although the switch current decreased rapidly, reached zero for a short time and continued to oscillate. Based on the test results the re-ignition happens at  $21\mu\text{s}$ , which contains  $14\mu\text{s}$  for switching and  $7\mu\text{s}$  for arc cooling. Therefore, their setup's calculated breakdown voltage for the 430A scenario is approximately 43V. In our model, we trace the voltage and current behaviours and the switching finished within  $8\mu\text{s}$ , hence, we select  $t=15\mu\text{s}$  to discuss thermal phenomena after  $7\mu\text{s}$  cooling as the experimental setup in [1]. Also, several cut-lines with different  $r$  positions are marked in Figure 9, the air gap along the axis cools down very quickly.

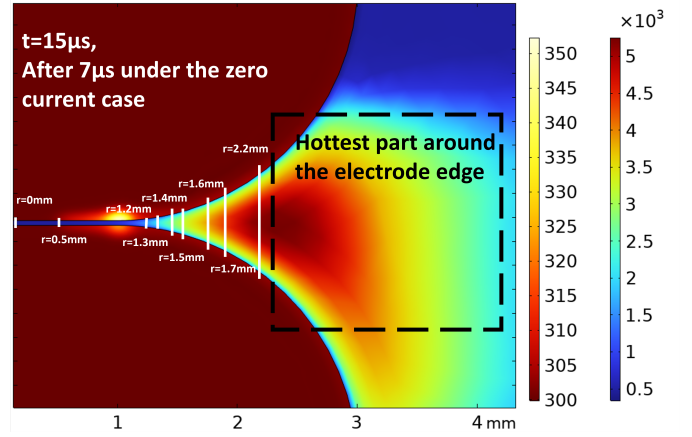


Fig. 9. Temperature distribution between  $40\mu\text{m}$ ,  $t=20\mu\text{s}$ , showing the very fast cooling between two electrodes

This rapid cooling suggests that for small gaps, typically on the micrometre scale, arc formation is highly influenced by the geometry of the electrodes. Rather than staying at the gap centre, the arc often shifts to the edge and moves in the gap, which is consistent with experimental observations reported in [16].

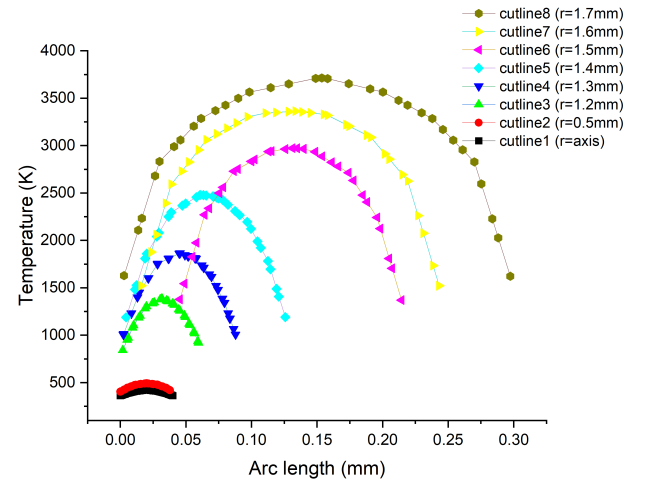


Fig. 10. Temperature distribution along the cut-line across, illustrating that the coldest air is between electrodes, the hottest part is around the electrode edge

Modelling results of the temperature distributions along the axial symmetry line and at the hottest cut-line are depicted in Figures 10. The calculated breakdown voltages are shown in Figure 11. The results show that the minimum breakdown occurs at  $r=1.2\text{mm}$  with a breakdown voltage of around 42.7V. This finding indicates that the breakdown does not happen at either the hottest or coldest part of the gap. The breakdown voltage along the axis is quite similar at  $r=2.2\text{mm}$ , which can be attributed to several factors. Although the symmetry line has a cooler average temperature resulting in a higher critical field, the breakdown voltage is also influenced by the small



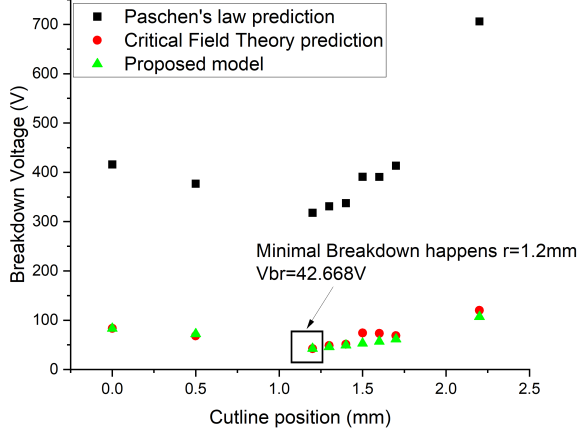


Fig. 11. Predicted Breakdown Voltage across the different cut-line for large gap size, illustrating the minimal breakdown happens at  $r=1.2\text{mm}$  and the breakdown voltage is around 42.7V, both Paschen Law and Critical Field models use an average temperature, whereas the proposed model takes into account temperature variation in the gap

$40\mu\text{m}$  gap distance. Conversely, the hottest part exhibits a much higher temperature and a lower critical field, but the length of the cut-line extends to  $227\mu\text{m}$  due to the filleted shape of the electrodes, effectively increasing the breakdown voltage despite the lower critical field. These observations highlight the complexity of the breakdown process, where multiple factors, including temperature distribution and gap geometry, interplay to determine the breakdown voltage.

### C. Comparison for model prediction with experimental data

Based on the comparison results presented in the table I, it is evident that the Critical Field Theory is the primary mechanism driving the breakdown in the observed phenomena. Our model, which integrates  $V_{br}(T(z))$ , has demonstrated relative accuracy in predicting the breakdown voltages. For small air gaps, the model shows good agreement with experimental data. Although there are some discrepancies between our model's predictions and the experimental data for large air gaps, the observed breakdown occurs between the predictions of Paschen's Law and the Critical Field Theory. The dominant mechanism driving the breakdown for large gap sizes remains unclear. These discrepancies are likely due to differences in the geometry of the experimental device; the model is axis-symmetrical, whereas the real device is three-dimensional. Specifically, the experimental setup uses the shape of the rectangular electrodes for a smooth sliding as shown in figure12, which may affect the cooling rate and subsequently the breakdown characteristics. Another observation is that the minimum breakdown voltage is dependent on both temperature and distance. The position of the breakdown path varies, highlighting the importance of modelling due to temperature variations. While experiments can indicate the breakdown characteristics in a particular setup, for modified geometry

accurate modelling can yield more precise breakdown voltage values.

Despite the limitations, our model provides a plausible explanation for the behaviour observed in compact circuit breakers, particularly the re-ignition phenomena. The data shows that the re-ignition is mainly driven by the Critical Field Theory, whereas Paschen's Law predictions are significantly off from the experimental results. We hypothesise that the effectiveness of Critical Field Theory during these short time intervals after current commutation can be attributed to the noticeable remaining background ionisation that occurs shortly after contact separation. It takes some time for electrons to be attached to the atoms and high temperature slows down the process. This high background ionisation facilitates the breakdown process, making Critical Field Theory a more accurate predictor in these scenarios.

The final verification was conducted using the published data on failed current interruption [1]. Unfortunately, the data only include max possible interrupted current for a given circuit parameter. The Critical Field model allows us to calculate the average gas temperature at which the breakdown was observed and compare it with MHD simulations. The failed commutation experimental data for maximum commutation current, according to different capacitance, could be replicated as shown in Table II. This replication is a strong indicator that our model can be used for circuit breaker design and supports the conclusion that the breakdown mechanism for compact circuit breakers with short gaps is driven by the Critical Field Theory.

But at the initial opening stage, it is worth noting that the Critical Field model works very well for short times/small gaps, with the gap increases we can see the increase in the breakdown voltage towards Paschen Law predictions, but still the breakdown voltages are much lower. As time progresses, the background ionisation reduces and a higher voltage is needed for the breakdown. Eventually, for large gaps after longer opening, the breakdown voltages are going to approach the Paschen Law values. The critical Field Theory effectively explains the breakdown and re-ignition phenomena in compact circuit breakers, especially for small air gaps within a sub-millimetre scale. Our model, despite minor discrepancies due to geometric differences, aligns well with experimental observations and supports the dominance of Critical Field Theory in these events. Conversely, Paschen's Law predictions are far removed from the observed reality, highlighting the need for models that consider the electron recombination dynamics in predicting breakdown behaviours.

## V. CONCLUSION

This paper revisits the application of electrical breakdown theory for short gaps filled with hot ionised air. Our study focused on two widely used theories: the adjusted Paschen's law for elevated temperatures and the Critical Field Theory. By contrasting modelling and experimental data, our analysis indicates that the Critical Field Theory is more applicable in describing the phenomena of contact openings in short air

TABLE I  
EXPERIMENTAL OBSERVATIONS AND MODEL PREDICTIONS COMPARISON

Breakdown Prediction Methods	Paschen's Law Prediction (VB_1) at average temperature	Critical Field Theory Prediction (VB_2) at average temperature	Our Model Integration Vbr(T(z)),minimal value
<b>Experimental Observation</b>			
Case 1: 200 $\mu$ s, 1.4kA current, 1mm gap, 700V, re-ignition			
Model Prediction Results	T average = 2080K, VB_1 = 1276.3V	T average = 2080K, VB_2 = 475V	Vbr = 472.58V
Case 2: 21 $\mu$ s, 430A current, re-ignition, breakdown at 43V			
Model Prediction Results	T average = 1177K, VB_1 = 318V	T average = 1177K, VB_2 = 42.3V	Vbr = 42.668V

TABLE II  
COMPARISON OF MODEL PREDICTION BASED ON BREAKDOWN MECHANISM OF CRITICAL FIELD THEORY VERSUS EXPERIMENTAL DATA FOR MAXIMUM COMMUTATION CURRENT COMPARED WITH TEMPERATURE PREDICTION IN FIGURE 13

Capacitance (uF)	Current (A)	Temperature (K)	Our model prediction, time selection	Breaking point
<b>Experimental data Failed commutation</b>		<b>Expected Average Temperature at Breaking Point</b>		
52	125.5	1050	2 $\mu$ s commutation, 7 $\mu$ s cooling, t=9 $\mu$ s	r=0.9mm
104	239	1100	3 $\mu$ s commutation, 7 $\mu$ s cooling, t=10 $\mu$ s	r=0.95mm
156	319	1250	4 $\mu$ s commutation, 7 $\mu$ s cooling, t=11 $\mu$ s	r=1mm
208	417.5	1250	7 $\mu$ s commutation, 7 $\mu$ s cooling, t=15 $\mu$ s	r=1.2mm

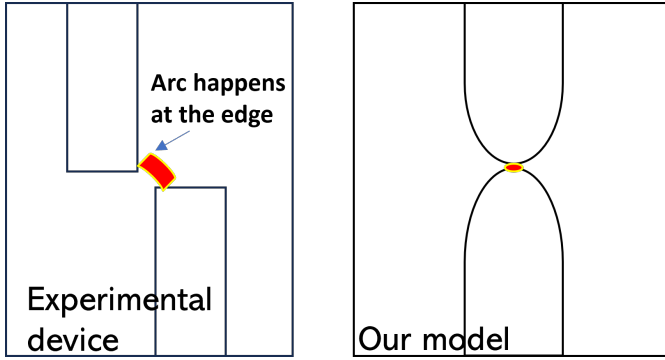


Fig. 12. Comparison of geometry differences between the experimental device and our model

gaps within the 1 mm distance frame. We hypothesises that the effectiveness of Critical Field Theory during these brief intervals is likely due to significant background ionisation shortly after contact separation. While our findings validate the Critical Field Theory for short durations, the potential applicability of Paschen's Law for longer intervals and times remains uncertain and warrants further exploration. Additionally, the breakdown behaviour is highly dependent on the temperature distribution in the vicinity of the electrodes, combining the effects of the variations in temperature and breakdown path length. The proposed model qualitatively agrees with the experiments. To conclude the exact role of ionisation and recombination dynamics in the re-ignition phenomena, a more complex plasma model is required.

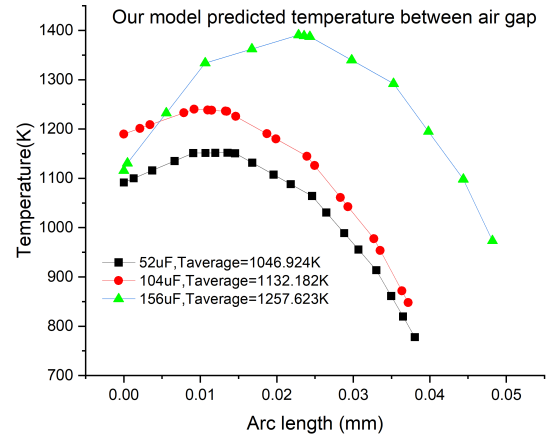


Fig. 13. The model temperature prediction in the air gap demonstrating close alignment with TableII and validating the model's predictive capability

## REFERENCES

- [1] D. Jovicic, "Fast commutation of DC current into a capacitor using moving contacts," *IEEE Transactions on Power Delivery*, vol. 35, no. 2, pp. 639–646, 2019.
- [2] D. Jovicic and S. Kovacevic, "Experimental evaluation of 5 kv, 2 ka, DC circuit breaker with parallel capacitor," *IEEE Transactions on Power Delivery*, vol. 37, no. 5, pp. 3510–3520, 2021.
- [3] V. Babrauskas, "Arc breakdown in air over very small gap distances," in *Conference: Interflam*, vol. 2, 2013, pp. 1489–1498.
- [4] K. Burm, "Calculation of the townsend discharge coefficients and the paschen curve coefficients," *Contributions to Plasma Physics*, vol. 47, no. 3, pp. 177–182, 2007.
- [5] G. Dandaron, G. Y. Dautov, and G. Mustafin, "Effect of gas temperature

on breakdown potential,” *Journal of Applied Mechanics and Technical Physics*, vol. 11, no. 1, pp. 140–143, 1970.

- [6] A. M. Loveless, G. Meng, Q. Ying, F. Wu, K. Wang, Y. Cheng, and A. L. Garner, “The transition to paschen’s law for microscale gas breakdown at subatmospheric pressure,” *Scientific reports*, vol. 9, no. 1, p. 5669, 2019.
- [7] H.-J. Jang, Y.-H. Oh, K.-D. Song, and Y.-I. Kim, “Prediction of reduced critical electric field strength of hot dry air in the temperature range 300–5000 K at 0.1 MPa for medium-voltage switchgear,” *AIP Advances*, vol. 10, no. 4, 2020.
- [8] T. Matsumura, Y. Yokomizu, P. C. Almiron, K. Yamamoto, D. Ohta, and M. Shibuya, “Breakdown voltage of CO<sub>2</sub> at temperatures around 4000K and in range from 300 to 700K,” *IEEE Transactions on Power and Energy*, vol. 125, no. 11, pp. 1063–1069, 2005.
- [9] Y. P. Raizer, “Gas discharge physics,” 1991.
- [10] D. B. Go and D. A. Pohlman, “A mathematical model of the modified paschen’s curve for breakdown in microscale gaps,” *Journal of Applied physics*, vol. 107, no. 10, 2010.
- [11] H.-J. Jang, Y.-H. Oh, K.-D. Song, and Y.-I. Kim, “Prediction of reduced critical electric field strength of hot dry air in the temperature range 300–5000 K at 0.1 MPa for medium-voltage switchgear,” *AIP Advances*, vol. 10, no. 4, p. 045103, 04 2020.
- [12] F. Karetta and M. Lindmayer, “Simulation of the gasdynamic and electromagnetic processes in low voltage switching arcs,” in *Electrical Contacts-1996. Proceedings of the Forty-Second IEEE Holm Conference on Electrical Contacts. Joint with the 18th International Conference on Electrical Contacts*. IEEE, 1996, pp. 35–44.
- [13] G. Lehner, “Elektromagnetische feldtheorie fuer physiker und ingenieure,” *Springer Verlag, Berlin, Heidelberg*, vol. 10, pp. 978–3, 1990.
- [14] J. Lowke, “Predictions of arc temperature profiles using approximate emission coefficients for radiation losses,” *Journal of Quantitative Spectroscopy and Radiative Transfer*, vol. 14, no. 2, pp. 111–122, 1974.
- [15] J. Nan, G. Chen, and I. Golosnoy, “Modelling of arcing phenomena during opening contacts in novel circuit breaker,” in *Proceedings of the 22nd International Symposium on High Voltage Engineering*. IET, 2023, pp. 701–707.
- [16] M. Rong, Q. Ma, Y. Wu, T. Xu, and A. B. Murphy, “The influence of electrode erosion on the air arc in a low-voltage circuit breaker,” *Journal of Applied Physics*, vol. 106, no. 2, 2009.